


SECTION A-A

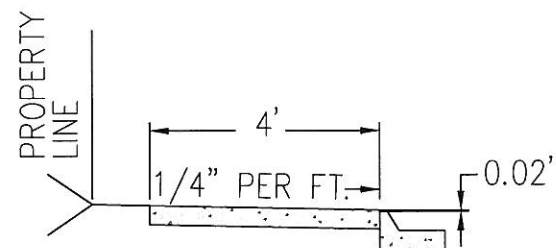

SECTION B-B

TYPICAL SIDEWALK DETAIL  
NO SCALE

NOTES

1. ONE HALF INCH EXPANSION JOINTS SHALL BE PLACED IN ALL SIDEWALKS AT INTERVALS OF NOT MORE THAN 100' AND AS SHOWN WHERE SIDEWALKS BUTT AGAINST CURB. IF THE SIDEWALK TO BE CONSTRUCTED IS LESS THAN 50' IN LENGTH ONE SUCH EXPANSION JOINT SHALL BE PLACED AS DIRECTED BY THE ENGINEER.
2. SIDEWALK SLOPE MAY BE VARIED TO SUIT EXISTING CONDITIONS. RECOMMENDED SLOPE TO BE 1/4" / FT. VARIATIONS TO SUIT EXTREME CONDITIONS TO BE AS DIRECTED BY THE ENGINEER. MAX. ALLOWABLE CROSS SLOPE = 1/4" PER FT. MAX. ALLOWABLE LONGITUDINAL SLOPE = 1" PER FOOT.
3. ALL SIDEWALKS 4 FEET OR MORE IN WIDTH SHALL BE SCORED IN PANELS NO GREATER THAN 4' SQUARE.
4. NO SIDEWALK REPAIR SHALL BE LESS THAN ONE COMPLETE PANEL.
5. SIDEWALK INSTALLED ADJACENT TO CURB SHALL BE INSTALLED 0.02' HIGHER THAN TOP OF CURB.
6. ALL NEW SIDEWALK SHALL HAVE THE PROPER HANDICAP ACCESS.
7. ALL HANDICAP RAMPS WILL BE STAMPED WITH DETECTION DOMES.

Revisions	By



Engineering Department  
1919 15th Avenue  
P.O. Box 1180  
Kearney, NE 68845-1180  
Phone: 308-233-3246  
Fax: 308-233-3223  
www.cityofkearney.org

**Sidewalk Details - Sheet 1 of 1**  
Kearney Standard Drawings

Date: 12/02/2015  
Drawn By: XXX  
Approved by: BAG  
Drawing Location: H:\Standard Specs and Plans - BAG \ Kearney Specs \ Standard Details \ Sidewalk.dwg