




Revisions	By



Engineering Department  
 1919 15th Ave  
 P.O. Box 1180  
 Kearney, NE 68845-1180  
 Phone: 308-233-3246  
 Fax: 308-233-3223  
 www.cityofkearney.org


# Sediment Control Details - Sheet 1 of 1

Kearney Standard Drawings

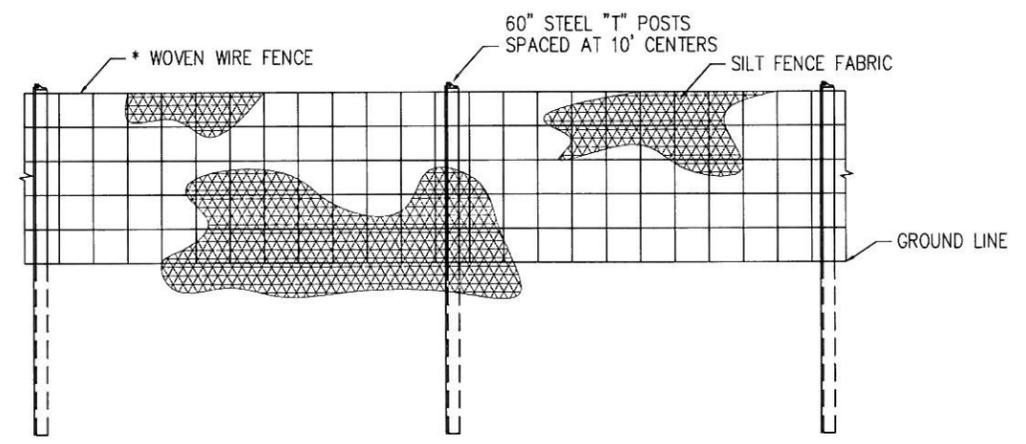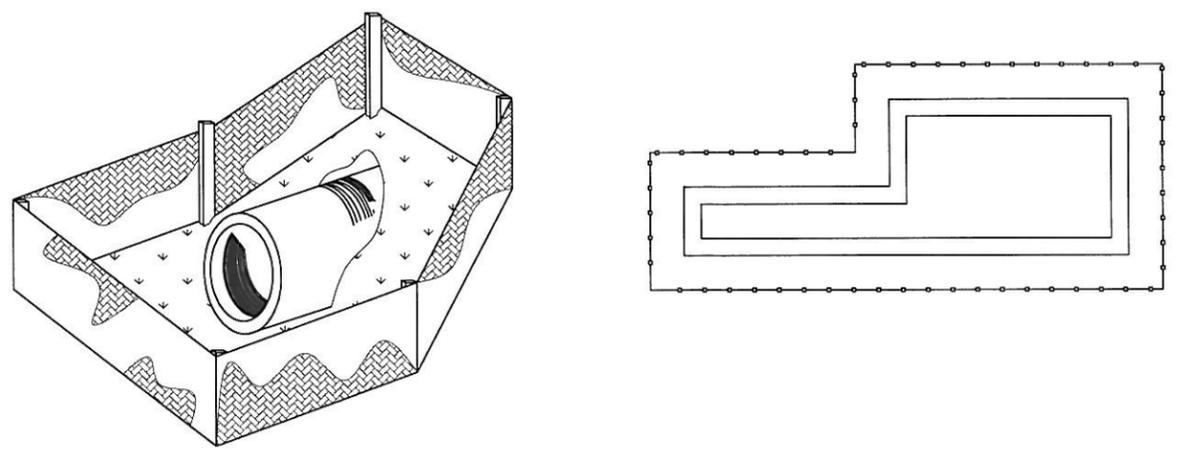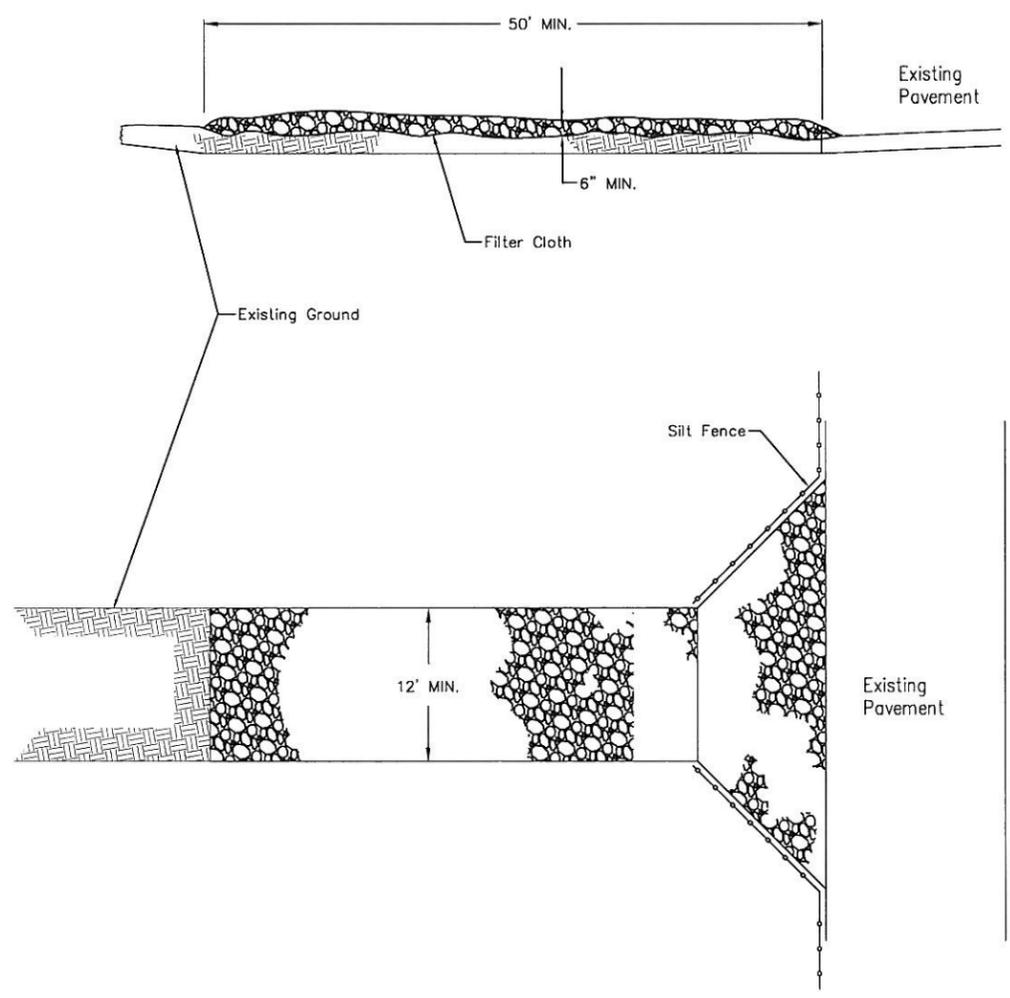

**Construction Entrance/Exit Installation:**

1. Stone Size - Use 2" stone, or reclaimed or recycled concrete equivalent.
2. Length - As required, but not less than 50 feet (except on a single residence lot where a 30 foot minimum length would apply).
3. Thickness - Not less than six (6) inches.
4. Width - Twelve (12) feet minimum, but not less than the full width at points where ingress or egress occurs.
5. Filter Cloth - Will be placed over the entire area prior to placing of stone. Filter will not be required on a single family residence lot.
6. Surface Water - All surface water flowing or diverted toward construction entrance shall be piped across the entrance.
7. Maintenance - The entrance shall be maintained in a condition which will prevent tracking or flowing of sediment onto public right-of-way. This may require periodic top dressing with additional stone as conditions demand and repair and/or clean out of any measures used to trap sediment. All sediment spilled, dropped, washed or tracked onto public rights-of-way must be removed immediately.
8. Washing - Wheels shall be cleaned to remove sediment prior to entrance onto public rights-of-way. When washing is required, it shall be done on an area stabilized with stone and which drains to an approved sediment trapping device.
9. Periodic inspection and needed maintenance shall be provided after each rain.

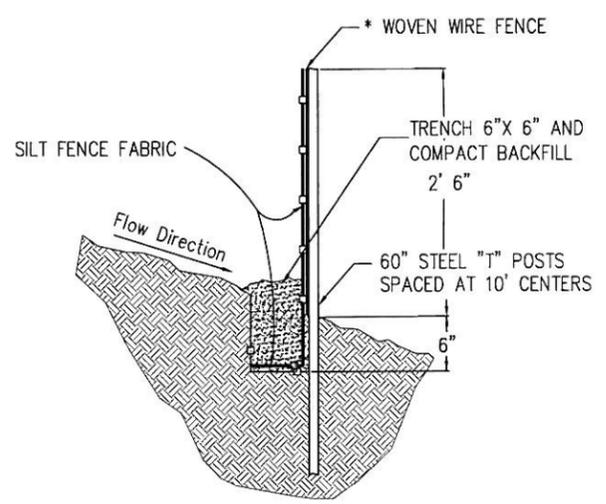

**SILT FENCE INSTALLATION:**

1. Dig a 6" x 6" trench.
2. Place posts into ground with fabric on upstream side of post, place fabric in trench.
3. Use excavated soil to backfill trench.
4. Woven wire fence shall be fastened to posts using wire ties on 24" centers, top, and middle.
5. When connecting two section of fabric overlap a minimum of 6'.
6. Maintenance shall be performed as needed and material shall be removed when 1/3 of the exposed fabric is covered.

Date: 12/02/2015

Drawn By: ALH

Approved by: BAG

Drawing Location:  
 H:\Standard Specs and Plates - BAC\Kearney\Specs\Standard Details\ESC Details.dwg